


The Geosmin peak at Water Treatment Plant intakes coincides with an increase in temperature at WTP intakes...

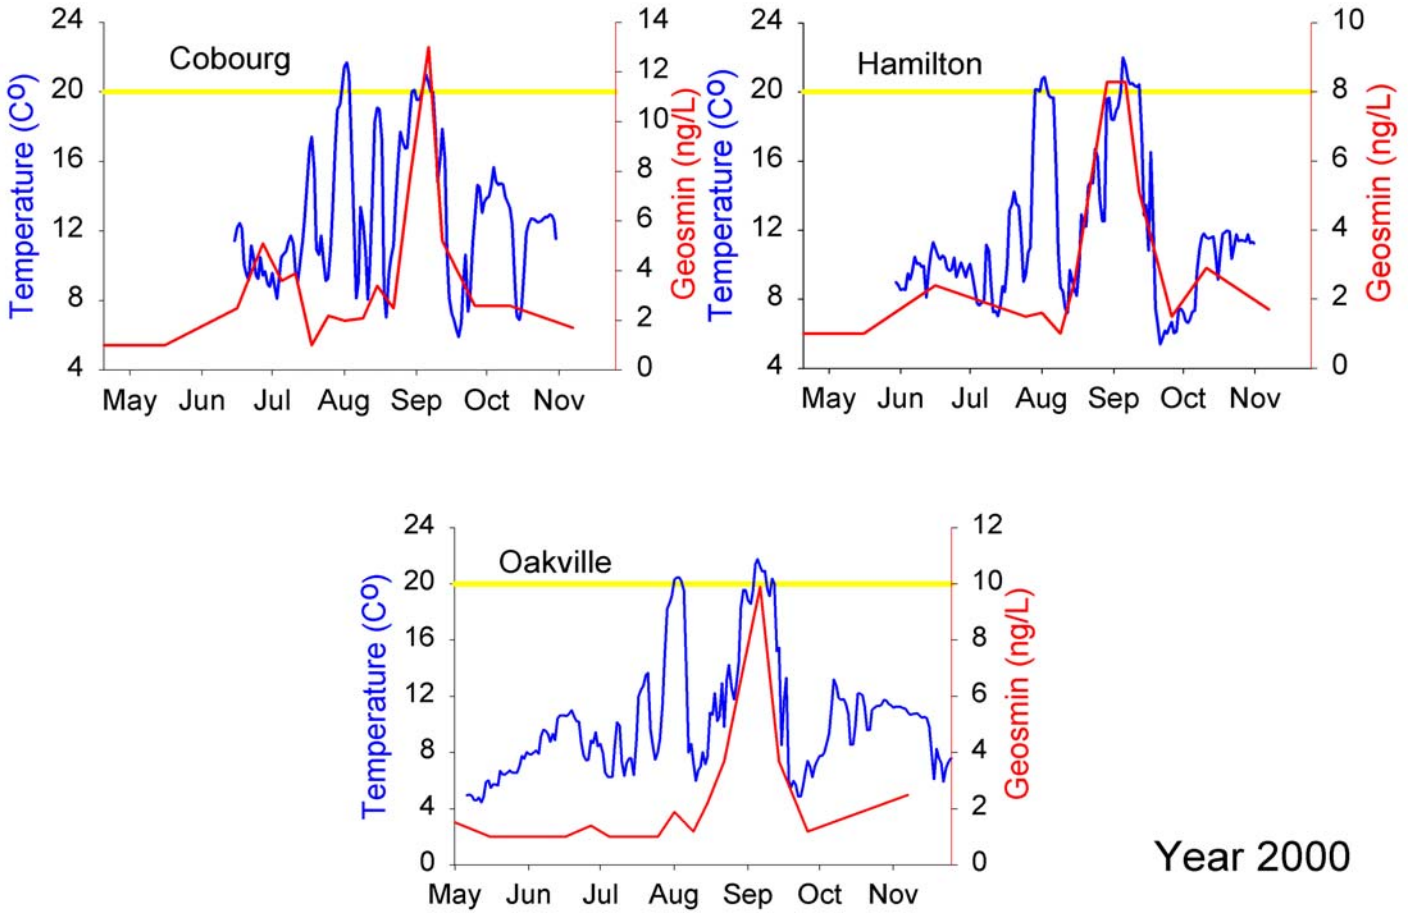

Year 2000